


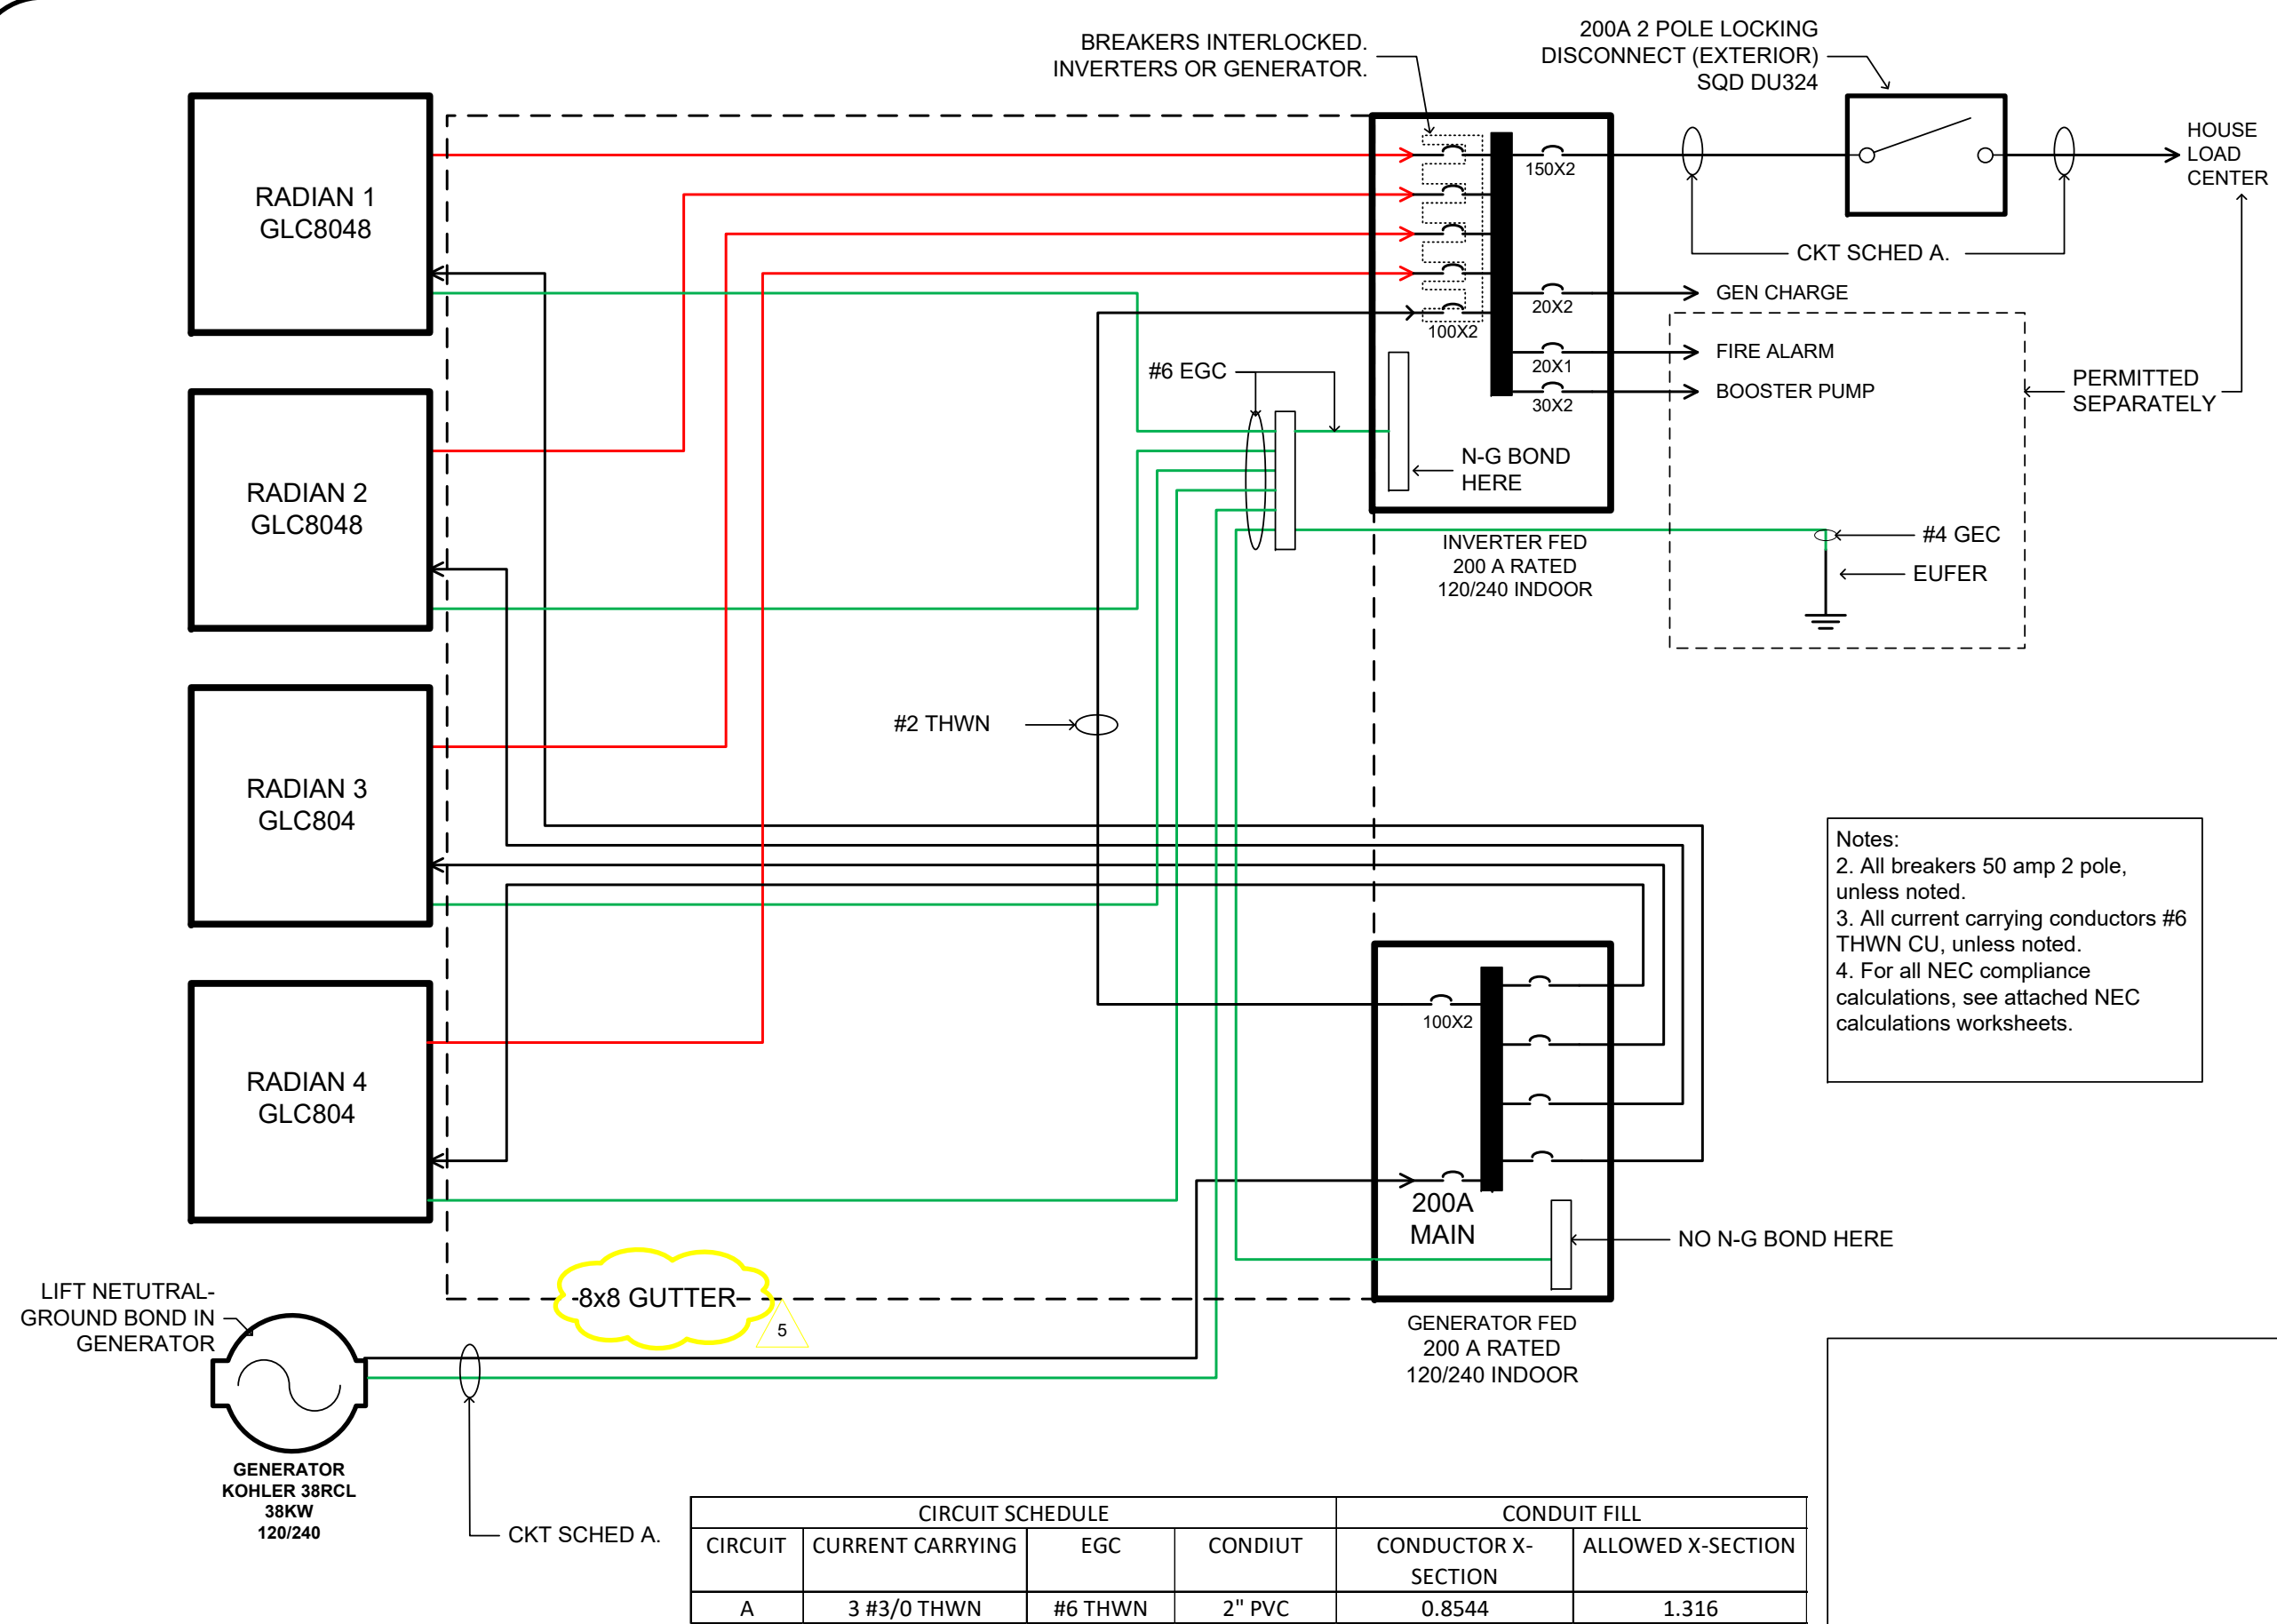

Notes:
2. All breakers 50 amp 2 pole, unless noted.
3. All current carrying conductors #6 THWN CU, unless noted.
4. For all NEC compliance calculations, see attached NEC calculations worksheets.

HUFFMAN POWER SYSTEM

8500 Chimney Rock Road
Paso Robles, CA 93446
APN: 014-311-033

AC 1-LINE

Design/Build Firm:

Miller Solar
17395 Oak Rd.
Atascadero, CA 93422
805/438/5600
millersolar.com
william@millersolar.com
William Miller, Principal
LIC NO 773985

Revisions

#	Date	Note
5	11/2/23	Cond/fill

SCALE

As Noted

DRAWN BY

W MILLER

DATE

11-25-16

PAGE

7 of 13