These leads are necessary

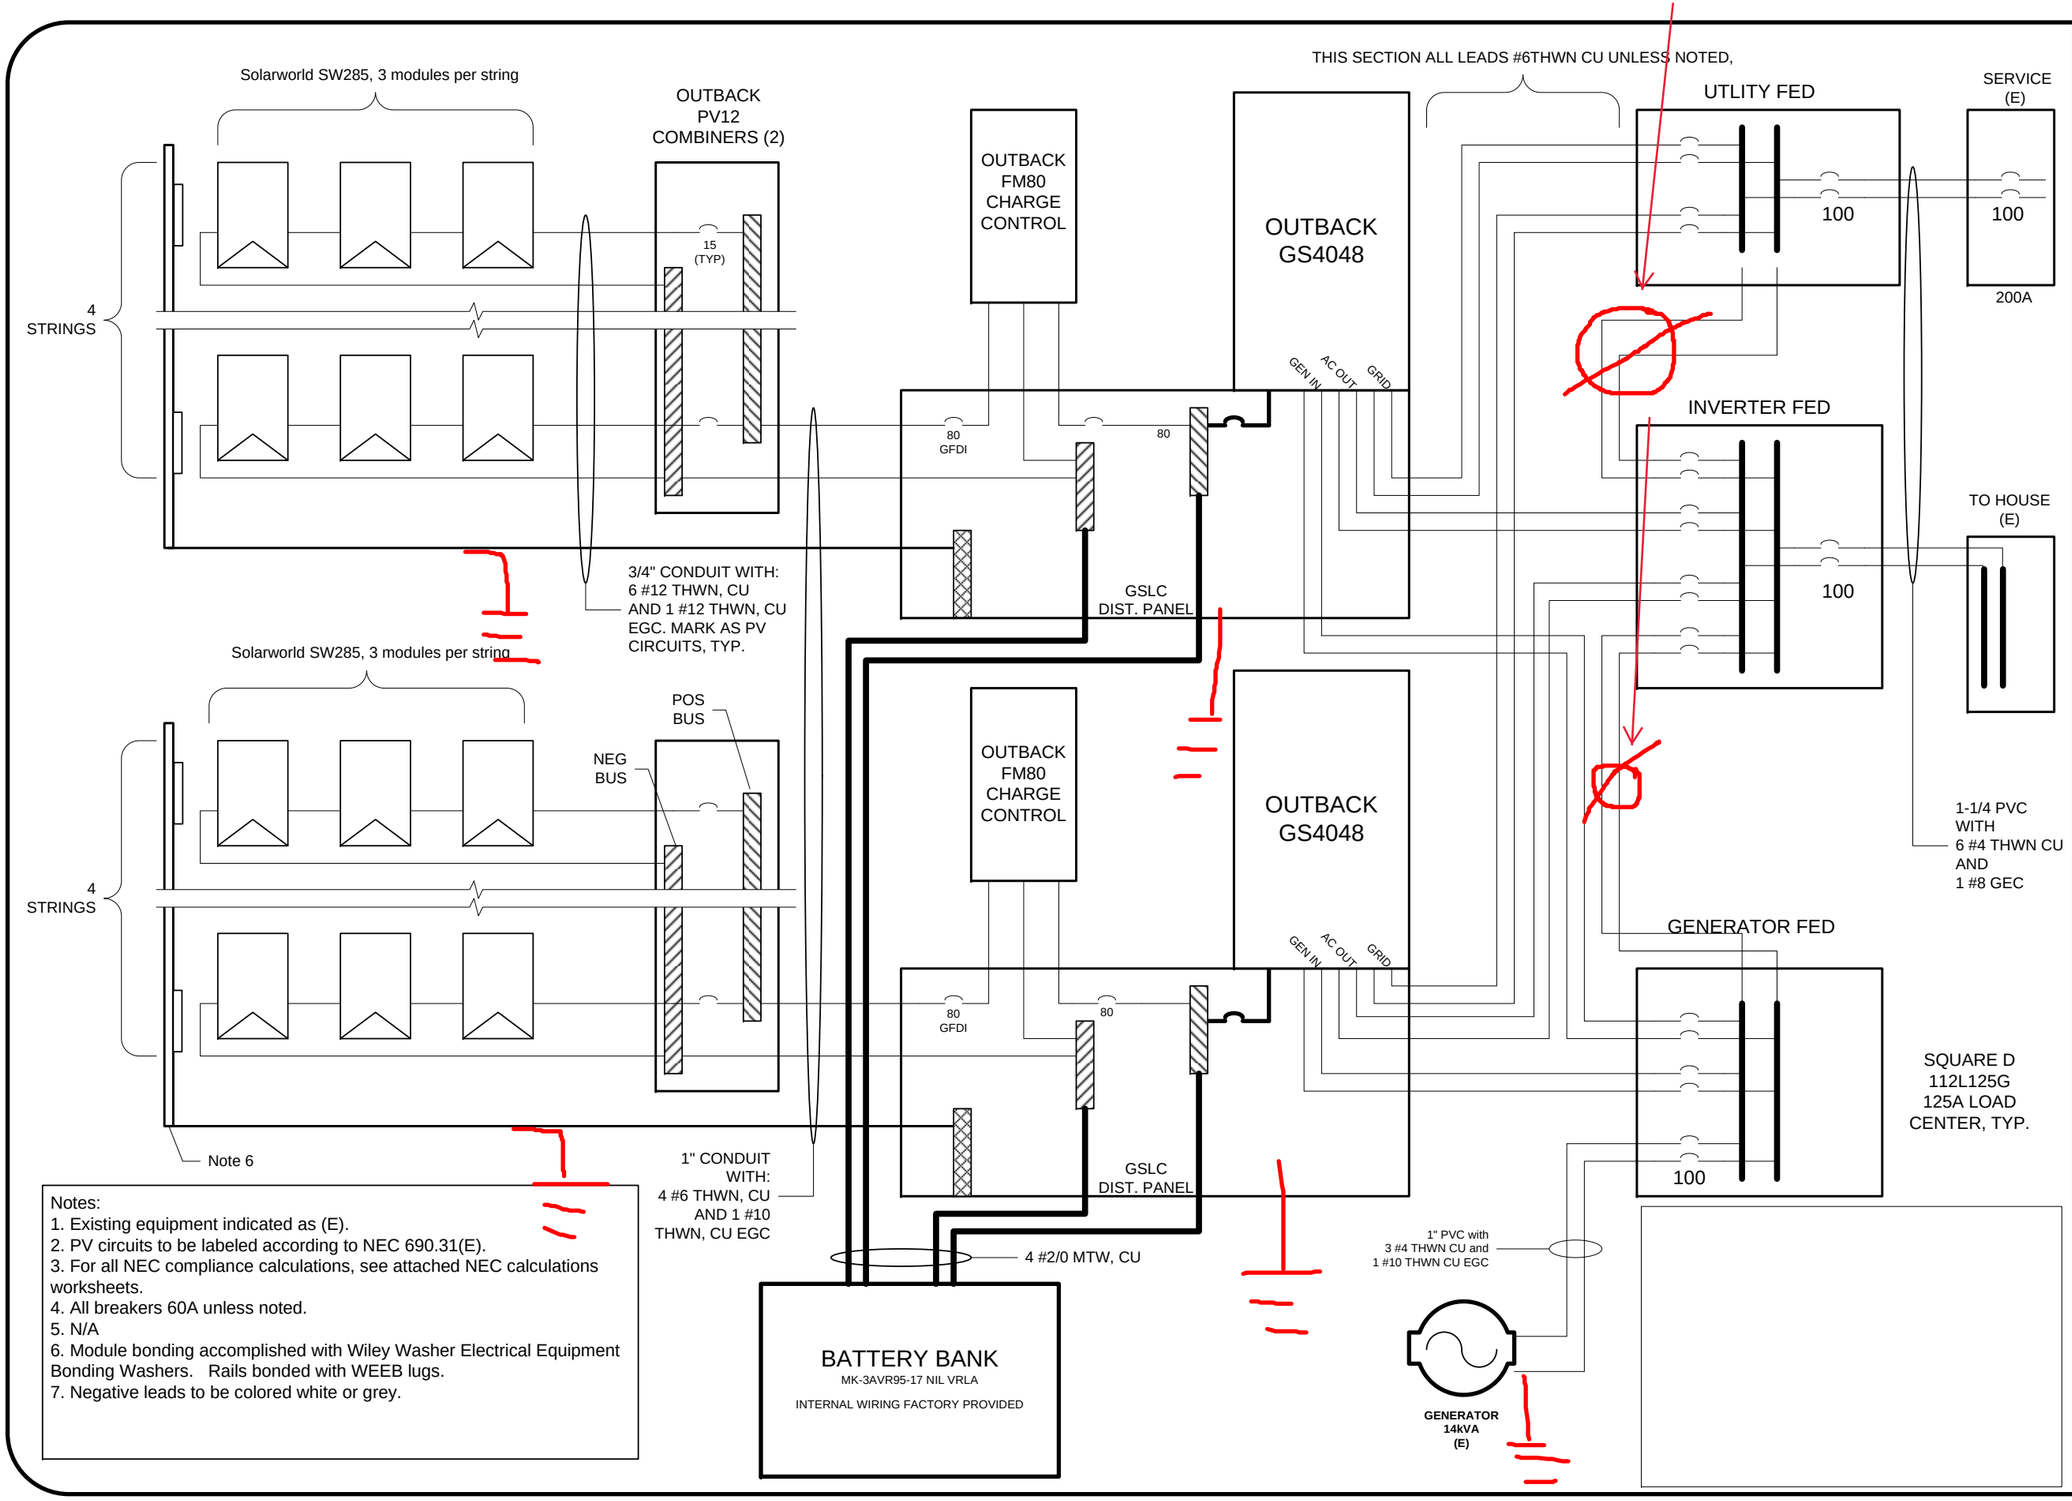

Notes:
1. Existing equipment indicated as (E).
2. PV circuits to be labeled according to NEC 690.31(E).
3. For all NEC compliance calculations, see attached NEC calculations worksheets.
4. All breakers 60A unless noted.
5. N/A
6. Module bonding accomplished with Wiley Washer Electrical Equipment Bonding Washers. Rails bonded with WEEB lugs.
7. Negative leads to be colored white or grey.

TITLE

NIX, TOM, GRID TIE-
BATTERY SOLAR ELECTRIC

Address: 7473 RUNNING DEER ROAD
PASO ROBLES, CA 93446
APN: 080-054-008

Subject

1 LINIE DIAGRAM

Design/Build Firm:

Miller Solar
17395 Oak Rd.
Atascadero, CA 93422
805/438/5600
millersolar.com
william@millersolar.com
William Miller, Principal

Revisions

#	Date	Note

SCALE
As Noted

DRAWN BY
WILLIAM

DATE
9-15-15

PAGE
4 OF 12